

**LA1**

# Combination Fire/Smoke Damper

Class I • 250°F or 350°F • 3 Hour • Galvanized Steel • Airfoil Blade

### STANDARD CONSTRUCTION

- FRAME:** 5 1/2" x 7/8" x 16-GA galvanized steel hat channel; A flat head and sill are used for sizes thru 13" high
- BLADES:** 20-GA galvanized steel double skinned (equal to 14-GA); Parallel action
- AXLES:** Plated solid steel stub
- BEARINGS:** Oil impregnated bronze
- LINKAGE:** Plated steel angle and crank plates with stainless steel pivots; In-jamb type
- STOPS:** 18-GA galvanized steel at head and sill
- BLADE SEALS:** Silicone
- JAMB SEALS:** Stainless steel
- SLEEVE:** Minimum 20-GA galvanized steel by 18" long (sizes greater than 84" wide or 84" high require minimum 18-GA)
- CAULKING:** Hardcast Irongrip 601 or UL-listed equivalent
- FINISH:** Mill on galvanized steel
- ACTUATOR:** Electric with heat response device (EHRD) or pneumatic with heat response device (PHRD); Factory-installed for Power-Open/Spring-Close (fail close) operation; External left hand mounted as viewed from jackshaft side of damper; Any additional actuators will be internally mounted

### OPTIONS

- Right hand and/or internal actuator mounting locations (restrictions apply)
- Integral Dual Position Indication (IDPI) switches
- Sensotherm re-openable heat response device (ESOT) for electric actuator
- Sensotherm re-openable heat response device (PSOT) for pneumatic actuator
- Model SM-501 Flow-rated smoke detector (10" minimum damper height)
- Model 2151 No-flow smoke detector (12" minimum damper height)
- Tab-Lock retaining angles
- Stainless steel bearings
- Copper tubing (for pneumatic actuators)
- Sleeves of various depths and gauge thicknesses
- No sleeve or sideplate only (restrictions apply)
- Round or oval transitions
- Short-width (<12") and/or short-height (<8") transitions


### STANDARD CONSTRUCTION

1. Damper frames are provided approximately 1/4" undersized. The addition of a sleeve will increase the size of the assembly.
2. Damper with smoke detector must have a minimum sleeve of 19" (10.5" on the actuator side and 3" on the non-actuator side).
3. Dampers for horizontal installation can only be mounted in a fire barrier constructed of masonry/concrete materials.

### STANDARD CONSTRUCTION


Orientation	Hor & Ver	Horizontal (floor)		Vertical (wall)	
		Min Panel	Max Panel	Max Assy	Max Panel
Rectangular	4"Wx4"H (12"Wx8"H frame)	30"Wx48"H	60"Wx48"H	30"Wx48"H	60"Wx48"H
Round	4" dia. (12"Wx8"H frame)	28" dia.	46" dia.	28" dia.	46" dia.
Oval	4"Wx4"H (12"Wx8"H frame)	28"Wx46"H	58"Wx46" h	28"Wx46"H	58"Wx46"H

\*Dampers smaller than minimum frame size require a transition. Reference SD-TRFS.

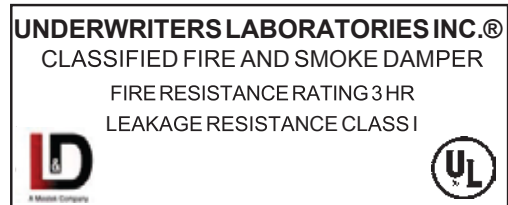

This combination fire/smoke damper meets the construction and performance requirements of:

- Underwriters Laboratories Inc. Standards 555 and 555S
- National Fire Protection Association Standards 90A, 92A, and 92B
- ICC's International Building Code
- ICBO's Uniform Building Code
- SBCCI's Standard Building Code
- BOCA's National Building Code
- New York City MEA Listing #111-99-M
- California State Fire Marshal Listing #3225-1328:118
- Underwriters Laboratories Inc. Approved for dual direction airflow and dynamic conditions.
- Underwriters Laboratories Inc. Classified for use in fire resistive ratings of 3 hours and longer.
- Underwriters Laboratories Inc. Classified for use in smoke control systems for Leakage Class I and 250°F or 350°F.
- Actuators must be arranged to operate automatically, must fail closed upon loss of power, and must be controlled by a smoke detection system.

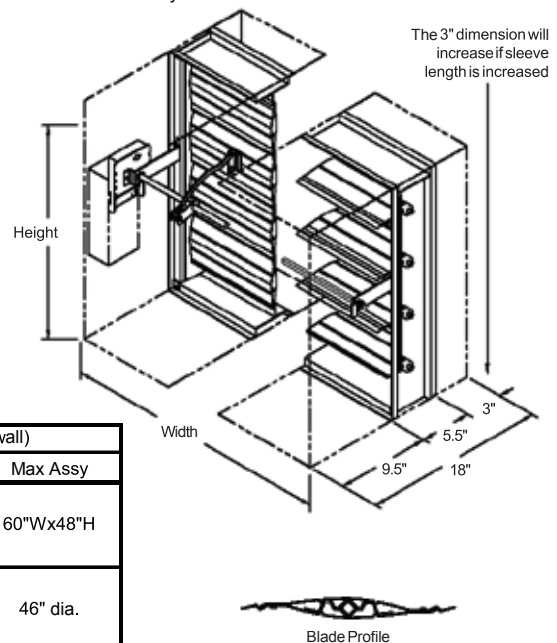

# LA1

## Combination Fire/Smoke Damper

Class I • 250°F or 350°F • 3 Hour • Galvanized Steel • Airfoil Blade

### Operations Ratings:

Maximum Differential Pressure: 4 in. wg

Maximum Velocity: 2000 fpm (3000 fpm for selected size/actuator combinations)

### Leakage Ratings:

UL Class I

4 cfm per sq. ft. maximum @ 1 in. wg


8 cfm per sq. ft. maximum @ 4 in. wg

### Sound Ratings:

None Available

### Pressure Drop Ratings:

The pressure drop data shown below is based on laboratory conditions. The test setup does not take into account elbows or other duct fittings that are part of every actual duct system. The configuration of the actual duct system immediately upstream and downstream of the damper often contributes more pressure loss than the damper itself.

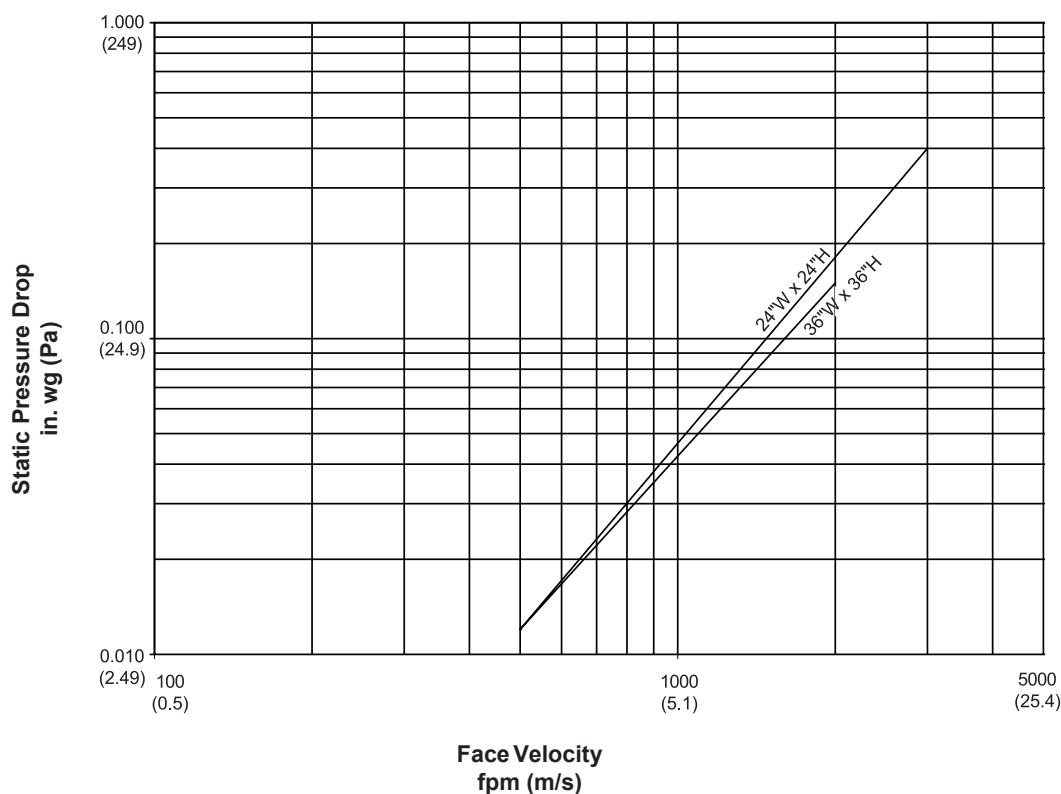

This product was tested in accordance with AMCA Standard 500D.

**AMCA Figure 5.3**

Motors	Min Panel	Max Single Panel	Max Assy
Belimo FSLF120 and FSLF24 (Available for 250°F only)	12\"W x 8\"H	2 sq.ft. 18\"H	n/a
Belimo FSNF120 and FSNF24 (Available for 250°F only)	12\"W x 8\"H	6 sq.ft. 36\"H	4.5 sq.ft

Additional actuator information can be found on LA1 Airfoil F/S Damper Motor Pricing.

# Combination Fire/Smoke Damper

# LA1

Class I • 250°F or 350°F • 3 Hour • Galvanized Steel • Airfoil Blade

## ADDENDUM SD-LA1 Extended Pressure & Velocity Ratings

### LA1 Extended Pressure & Velocity Ratings

Damper Style	Temp Rating (°F)	Velocity & Pressure	Horizontal & Vertical Min Panel	Horizontal (floor mount)		Vertical (wall mount)	
				Max Panel	Max Assy	Max Panel	Max Assy
No Transition	250° - or - 350°	2000 fpm, 4" w.g.	8" x 6" frame	30" x 48" frame	60" x 48" frame	30" x 48" frame	60" x 48" frame
		3000 fpm, 4" w.g.		24" x 36" frame - or - 30" x 24" frame	60" x 48" frame	24" x 36" frame - or - 30" x 24" frame	60" x 48" frame
		4000 fpm, 4" w.g.		24" x 36" frame - or - 30" x 24" frame	60" x 36" frame	24" x 36" frame - or - 30" x 24" frame	60" x 36" frame
		4000 fpm, 6" w.g. (external act only for 350°)		16" x 24" frame	n/a	16" x 24" frame	n/a
C-Round - or - C-Square	250° - or - 350°	2000 fpm, 4" w.g.	4" dia. duct - or - 4" x 4" duct  (8" x 6" frame)	28" dia. duct - or - 28" x 28" duct	46" dia. duct - or - 46" x 46" duct	28" dia. duct - or - 28" x 28" duct	46" dia. duct - or - 46" x 46" duct
		3000 fpm, 4" w.g.		22" dia. duct - or - 22" x 22" duct	46" dia. duct - or - 46" x 46" duct	22" dia. duct - or - 22" x 22" duct	46" dia. duct - or - 46" x 46" duct
		4000 fpm, 4" w.g.		22" dia. duct - or - 22" x 22" duct	34" dia. duct - or - 34" x 34" duct	22" dia. duct - or - 22" x 22" duct	34" dia. duct - or - 34" x 34" duct
		4000 fpm, 6" w.g. (external act only for 350°)		14" dia. duct - or - 14" x 14" duct	n/a	14" dia. duct - or - 14" x 14" duct	n/a
C-Oval - or - C-Rectangle	250° - or - 350°	2000 fpm, 4" w.g.	4" x 4" duct  (8" x 6" frame)	28" x 46" duct	58" X 46" duct	28" x 46" duct	58" X 46" duct
		3000 fpm, 4" w.g.		22" x 34" duct - or - 28" x 22" duct	58" x 46" duct	22" x 34" duct - or - 28" x 22" duct	58" x 46" duct
		4000 fpm, 4" w.g.		22" x 34" duct - or - 28" x 22" duct	58" x 34" duct	22" x 34" duct - or - 28" x 22" duct	58" x 34" duct
		4000 fpm, 6" w.g. (external act only for 350°)		14" x 22" duct	n/a	14" x 22" duct	n/a

*all dimensions are shown as width x height  
for NO TRANSITION, order size = frame size = duct size  
unless otherwise noted, duct size = order size  
WITH TRANSITIONS, damper frame size = order width + 2" x order height + 2"*